



### ALLEGHENY STRUCTURAL COMPONENTS, INC.

LISTEE: BARRETTE STRUCTURAL, INC.

### Open Joist 2000® and Open Joist TRIFORCE® Wood Trusses

CSI Section: 06 17 53 – Shop-Fabricated Wood Trusses

#### 1.0 RECOGNITION

The Open Joist 2000® and Open Joist TRIFORCE® wood trusses recognized in this report, have been evaluated for equivalent fire-resistant construction to dimension lumber of 2-inch by 10-inch nominal dimension in accordance with Exception 4 of Section R302.13 of the 2015 International Residential Code (Section R501.3 of the 2012 International Residential Code) in compliance with the following code editions:

- 2015 and 2012 International Residential Code® (IRC)

#### 2.0 LIMITATIONS

Use of the wood trusses recognized in this report is subject to the following limitations.

**2.1** The Open Joist 2000® and Open Joist TRIFORCE® wood trusses have only been evaluated for the fire-resistance requirements noted in Section 1.0. All other requirements shall be evaluated by an approved evaluation service.

**2.2.** Selection of the floor trusses for structural loading and its supporting structure shall be designed by a licensed professional.

**2.3** The trusses shall be properly braced in accordance with the installation instructions and the IRC.

#### 3.0 PRODUCT USE

**3.1 Design.** Open Joist 2000® and Open Joist TRIFORCE® wood trusses shall be designed in accordance with manufacturers’ design information, ANSI/AWC National Specification for Wood Construction (NDS) and evaluation reports by an approved and accredited certification agency.

**3.1.1 Fire Resistance Construction.** A minimum 9<sup>3</sup>/<sub>8</sub>-inch (238 mm) deep truss at a maximum spacing of 24 inches shall (610 mm) be required to offer equivalent fire performance to 2-inch by 10-inch nominal dimension solid sawn lumber and are recognized for installation without the prescribed minimum 1/2-inch-thick (12.7 mm) gypsum wallboard or 5/8-inch (15.9 mm) thick wood structural panel membrane in

accordance with Exception 4 to the 2015 IRC Section R302.13 or Section R501.3 for the 2012 IRC when installed as described in this report.

**3.2 Installation.** Installation of the Open Joist 2000® and Open Joist TRIFORCE® shall be in accordance with manufacturer’s installation guide, this evaluation report and the applicable provisions of the IRC. The joists are imprinted with the words top and bottom on their respective flanges to assure installation is as designed. Where there is a conflict between these documents, the most restrictive provisions shall govern. The manufacturers installation instructions and this report shall be available at the jobsite during construction for use by installers and for quality assurance.

#### 4.0 PRODUCT DESCRIPTION

**4.1 General:** Open Joist 2000® and Open Joist TRIFORCE® wood trusses are prefabricated open web floor joists constructed of solid-sawn wood. Web members are connected to flanges by adhesively bonded finger joints.

**4.1.1 Flanges.** The top and bottom flanges are constructed of solid-sawn or finger-jointed Spruce-Pine-Fir (SPF) lumber with a minimum 2-inch by 3-inch nominal dimension.

**4.1.2 Web Members.** The vertical and diagonal web members are constructed of minimum nominal 2-inch by 2-inch SPF lumber.

An extension is provided on one or both ends of the trusses which can be cut, according to manufacturer’s installation instructions, to adjust the length of the joist. The TRIFORCE® truss uses a 5/8-inch wood structural panel or 1/2-inch gypsum board attached to each side of a 3/8-inch wood structural panel for the extension and the Open Joist 2000® truss uses a 2-inch by 8-inch solid-sawn lumber web for the extension.

**4.1.3 Adhesive.** The adhesive used for manufacturing the trusses complies with ASTM D2559 and qualifies under the heat durability performance requirements of ASTM D7247.


The product described in this Uniform Evaluation Service (UES) Report has been evaluated as an alternative material, design or method of construction in order to satisfy and comply with the intent of the provision of the code, as noted in this report, and for at least equivalence to that prescribed in the code in quality, strength, effectiveness, fire resistance, durability and safety, as applicable, in accordance with IBC Section 104.11. This document shall only be reproduced in its entirety.





## 5.0 IDENTIFICATION

The bottom flange of the product is imprinted with the manufacturer's name, manufacturer's phone number, product name, approved inspection agency, the UES Mark of conformity and evaluation report number (ER-480). Either UES Mark of Conformity may be used as shown below:

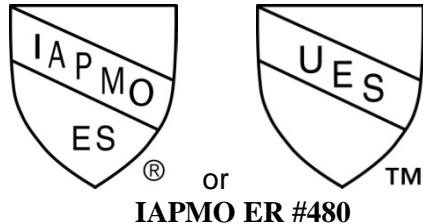

## 6.0 SUBSTANTIATING DATA

- 6.1 Report of Fire-resistance in accordance with ASTM E119 from a laboratory in compliance with ISO/IEC 17025.
- 6.2 Technical Assessment of Fire Performance.
- 6.3 Engineering analysis.
- 6.4 Manufacturer's quality documentation, descriptive literature and installation instructions.

## 7.0 CONTACT INFORMATION

**Allegheny Structural Components, Inc.**  
3778 Oneida Valley Road  
Emlenton, Pennsylvania 16373  
Phone: (724) 867-1100  
<http://www.alleghenystructural.com>

**Barrette Structural, Inc.**  
555 Rang St-Malo  
Trois-Rivieres, Quebec G8V 0A8  
Canada  
Phone: (800) 263-7265  
<http://www.openjoisttriforce.com>

## 8.0 STATEMENT OF RECOGNITION

This evaluation report describes the results of research carried out by IAPMO Uniform Evaluation Service on Open Joist 2000® and Open Joist TRIFORCE® wood trusses to assess their conformance to the codes shown in Section 1.0 of this report and documents the product's certification.

**Brian Gerber, P.E., S.E.**  
Vice President, Technical Operations  
Uniform Evaluation Service

**Richard Beck, PE, CBO, MCP**  
Vice President, Uniform Evaluation Service

**GP Russ Chaney**  
CEO, The IAPMO Group

For additional information about this evaluation report please visit [www.uniform-es.org](http://www.uniform-es.org) or email at [info@uniform-es.org](mailto:info@uniform-es.org)